
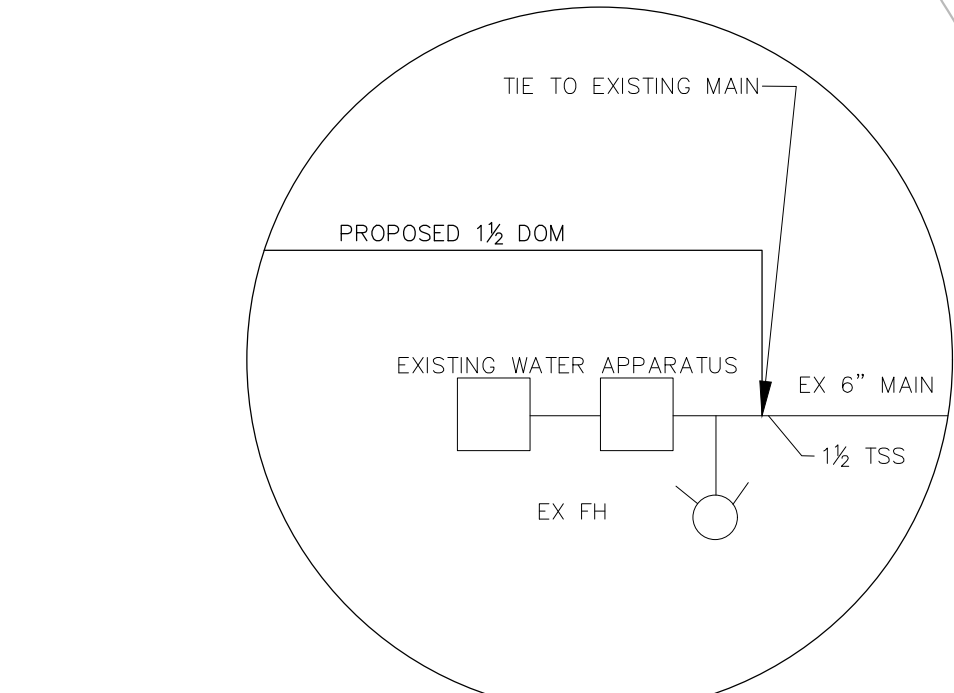



1. PROVIDE AND INSTALL NEW WATER SERVICE. INQUIRE WITH LOCAL AUTHORITIES TO DETERMINE IF BACKFLOW PREVENTER IS REQUIRED. IF AVAILABLE PRESSURE IS LESS THAN 60 PSIG AT THE BUILDING, CONTACT HARDEE'S CONSTRUCTION REPRESENTATIVE. PROVIDE REMOTE READER. FIELD COORDINATE WITH WATER COMPANY AND SITE CONTRACTOR. COORDINATE LOCATION WITH SITE CONTRACTOR.

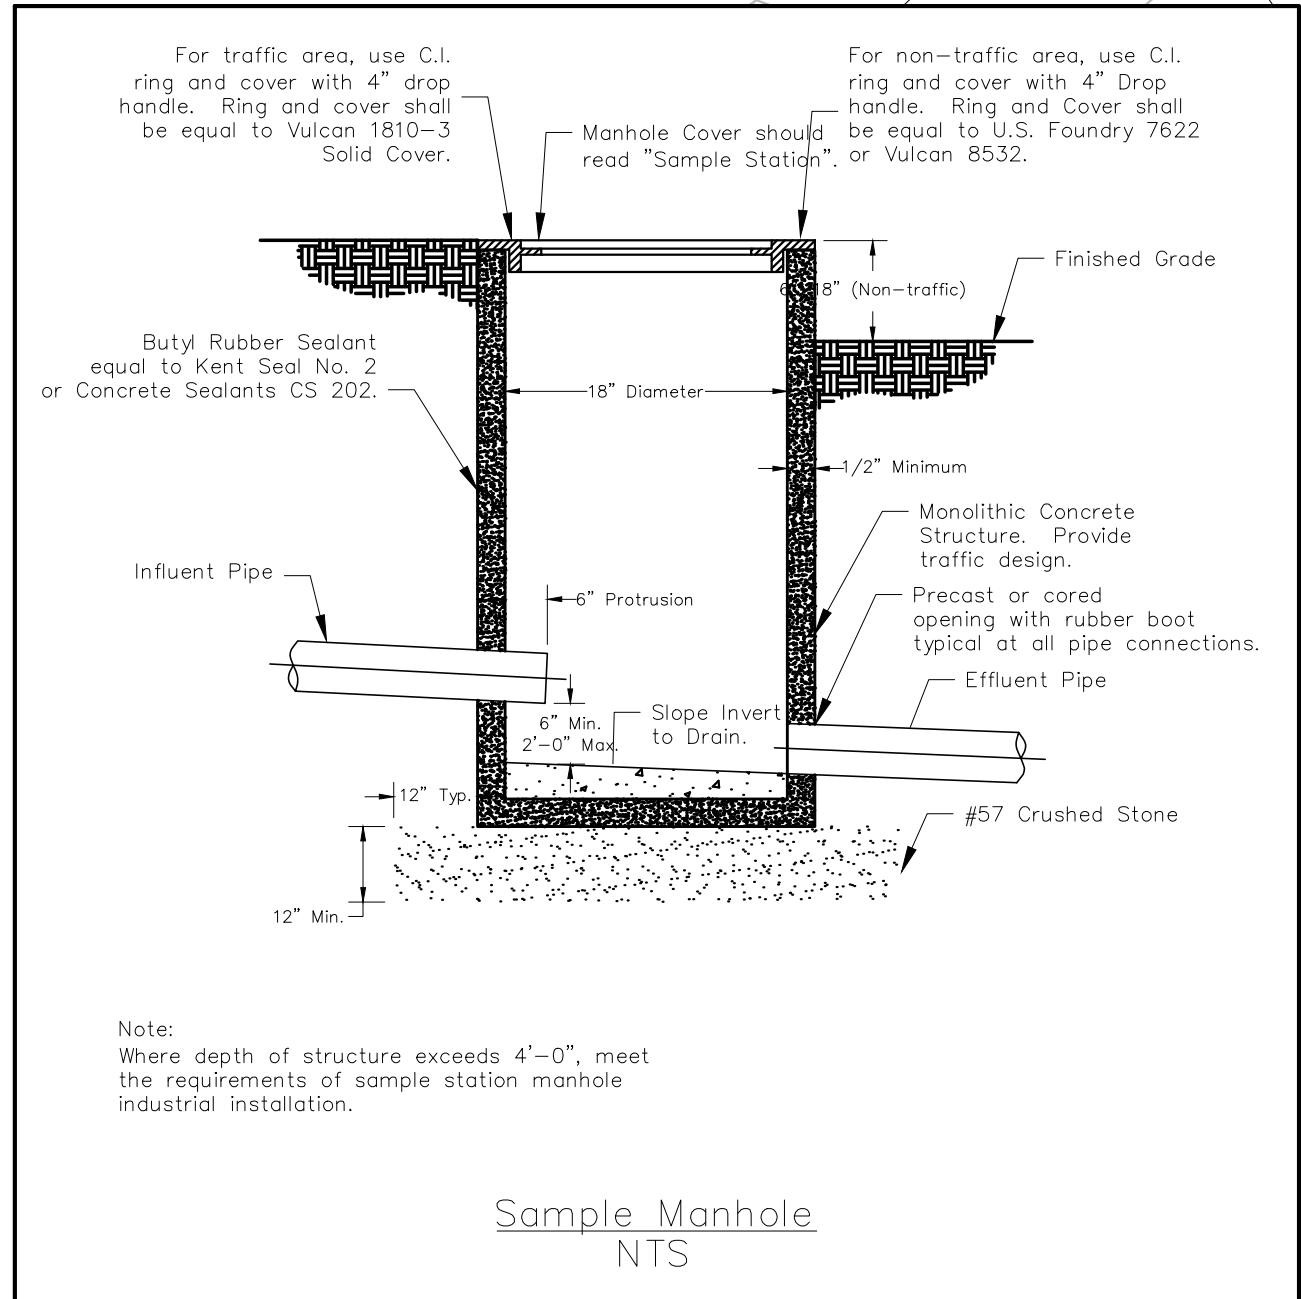

811
Know what's below.
Call before you dig.

IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONTACT UTILITY COMPANIES PRIOR TO ANY CONSTRUCTION AS THE LOCATION OF UTILITIES SHOWN ON THIS PLAN ARE APPROXIMATE AND POSSIBLY INCOMPLETE. THEREFORE CERTIFICATION TO THE LOCATION OF ALL UNDERGROUND UTILITIES ARE WITHHELD.

ATLANTA HIGHWAY
(200' RW, ASPHALT PAVED, PUBLIC, VARIABLE WIDTH)
PB 37 - PG 16

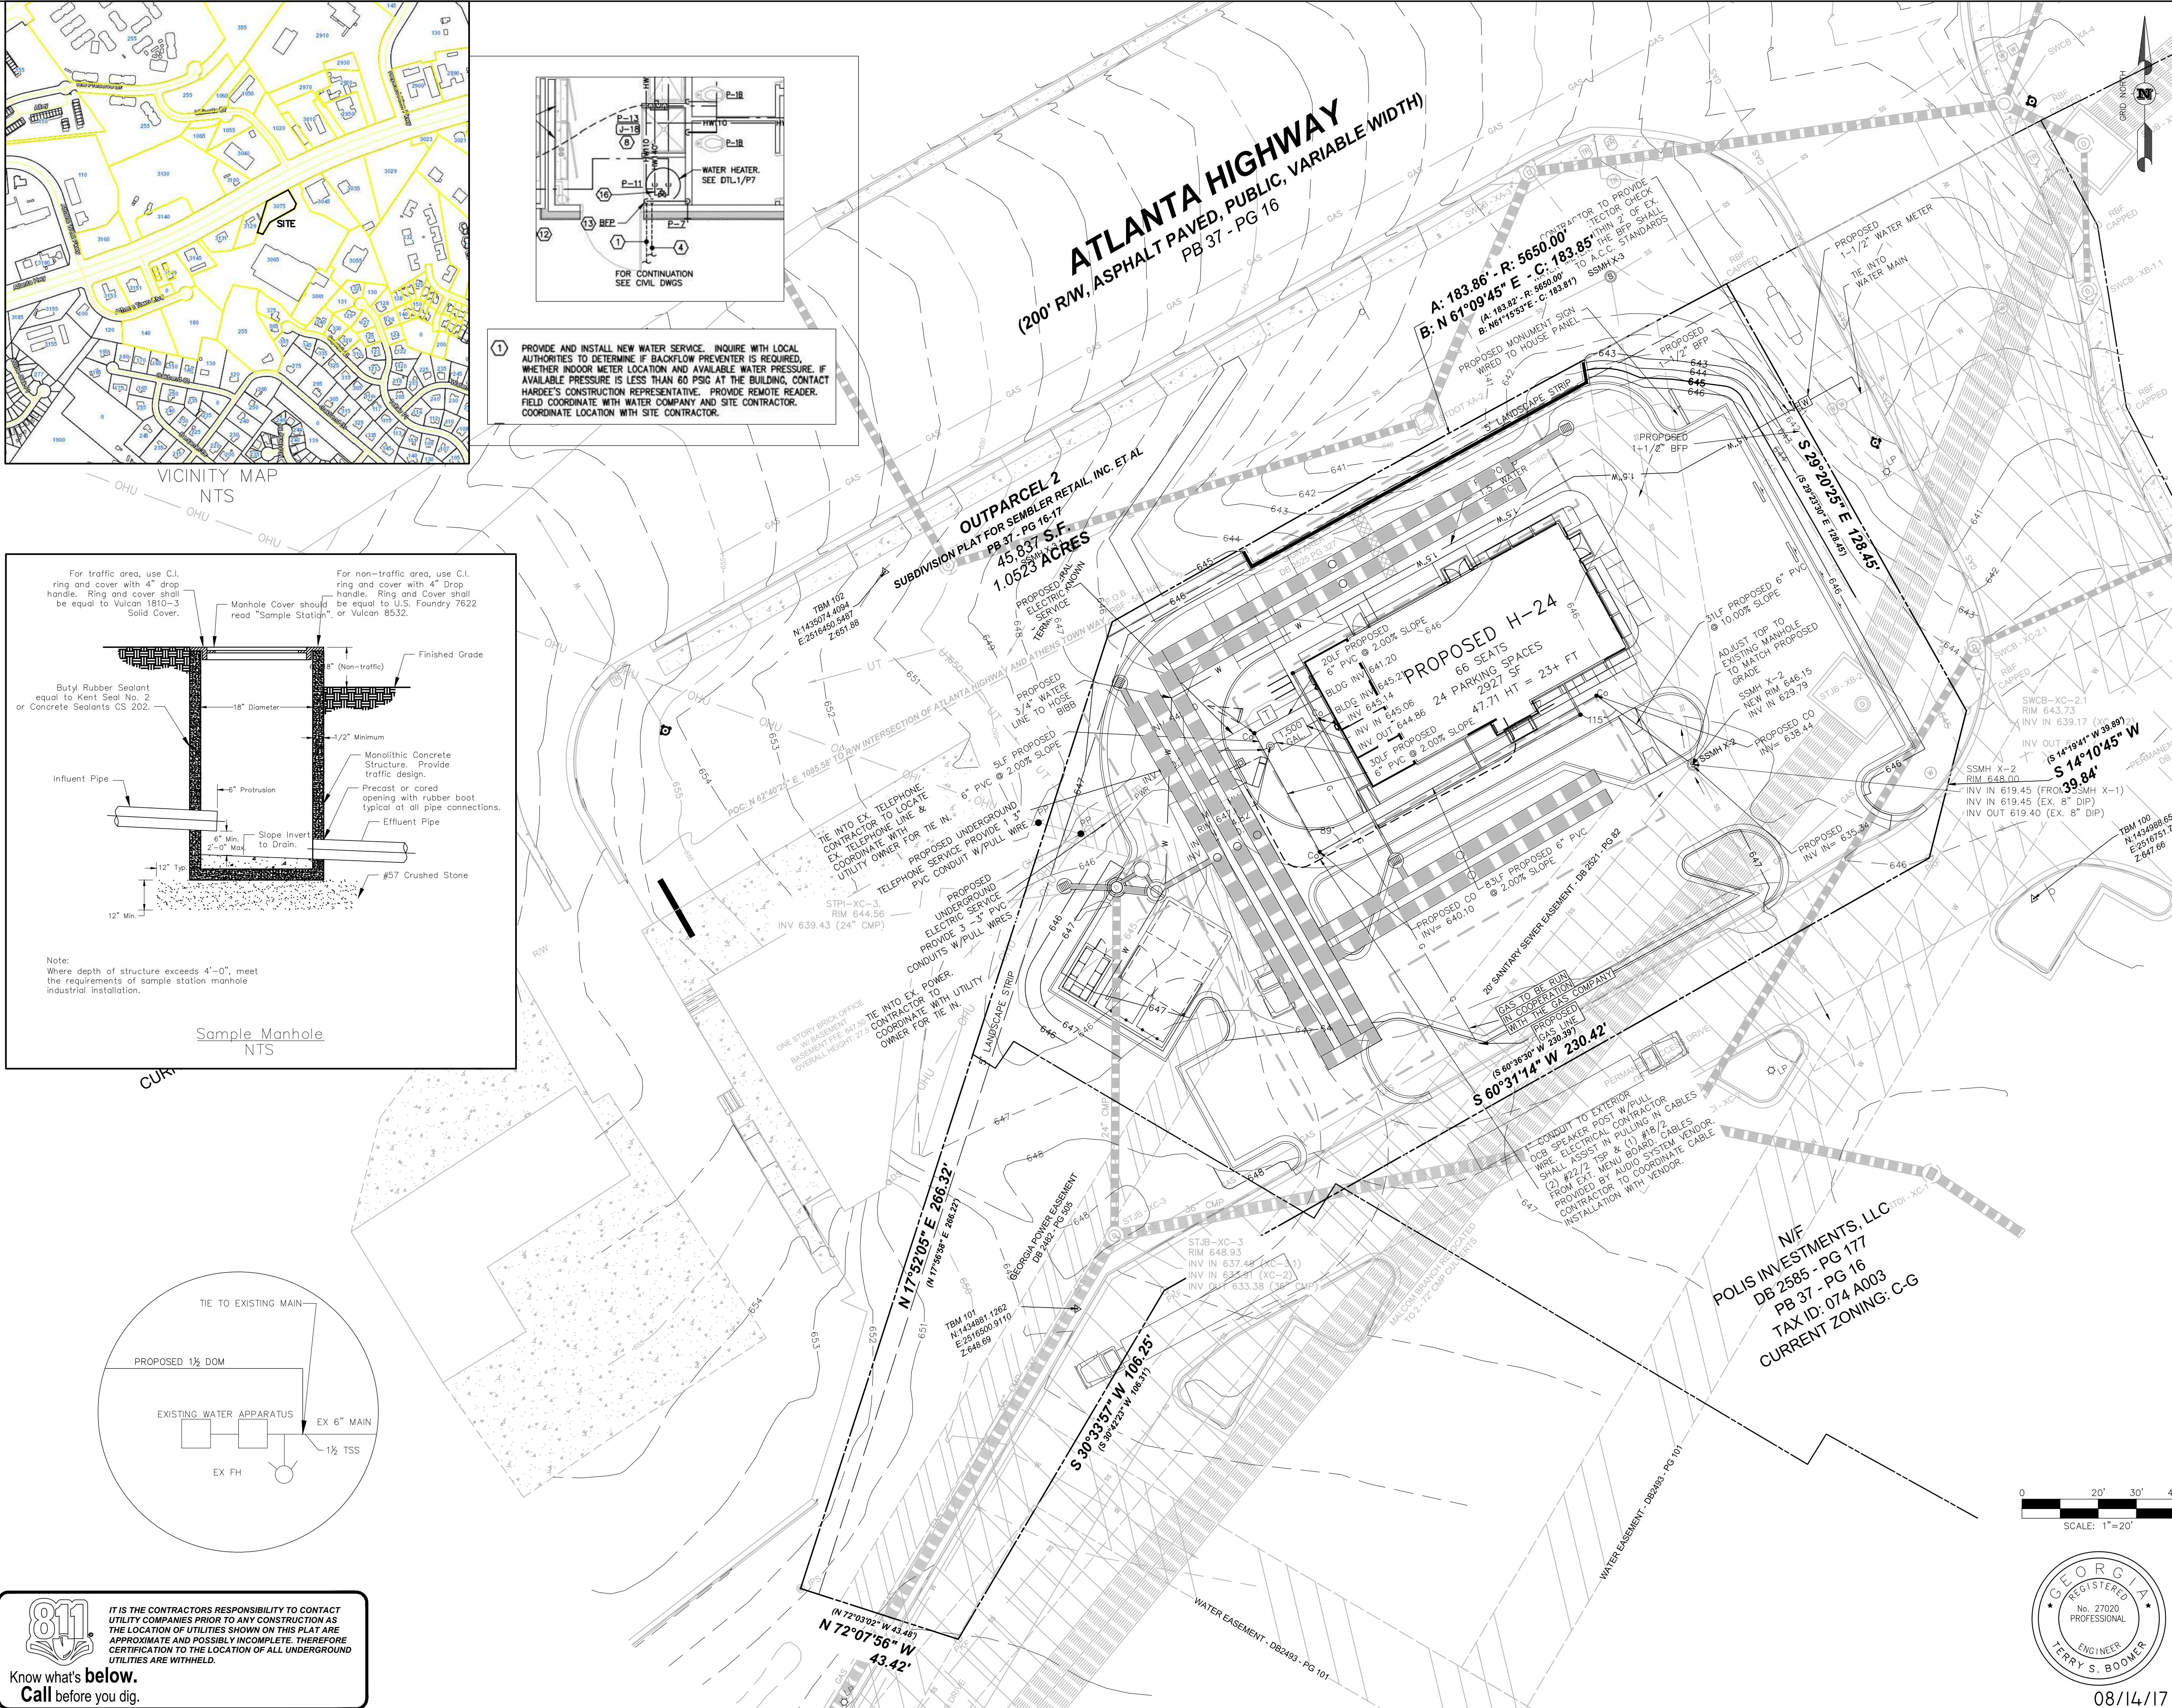

- UTILITY NOTES:
- STANDARD SPECIFICATIONS AND DETAILS SHALL GOVERN ALL WATER AND SANITARY SEWER MAIN CONSTRUCTION.
 - THE BUILDING CONTRACTOR IS RESPONSIBLE FOR LOCATION, SIZE AND SPECIFICATIONS OF ALL ELECTRICAL TRANSFORMER PADS FROM THE LOCAL POWER COMPANY AND PROVIDING SERVICE FROM THE TRANSFORMER TO THE BUILDING.
 - CONTRACTOR SHALL COORDINATE ANY DISRUPTIONS TO EXISTING UTILITY SERVICES WITH ADJACENT PROPERTY OWNERS AND IS RESPONSIBLE FOR REPAIRS OF DAMAGE TO ANY EXISTING UTILITIES DURING CONSTRUCTION AT NO EXTRA COST TO THE OWNER.
 - CONTRACTOR SHALL COMPLY TO THE FULLEST EXTENT WITH THE LATEST STANDARDS OR OSHA DIRECTIVES OR ANY OTHER AGENCY HAVING JURISDICTION FOR EXCAVATION AND TRENCHING PROCEDURES. THE CONTRACTOR SHALL SUPPORT SYSTEMS, SLOPING, BENCHING AND OTHER MEANS OF PROTECTION. THIS TO INCLUDE BUT NOT LIMITED TO ACCESS AND EGRESS FRAMES 4" AND LARGER SHALL BE CAST IRON OR DUCTILE IRON CONFORM WITH WWA STANDARD SPECIFICATIONS.
 - SANITARY SEWER PIPE SHALL BE PVC SDR 26 ASTM 3034 FOR PIPES LESS THAN 12" DEEP. PVC PIPE SHALL BE BELL & SPIGOT TYPE WITH INTEGRAL BELL AND RUBBER GASKETS. DUCTILE IRON CLASS 52 AWA C150, ANSI: A21.51 WITH PUSH ON OR MECHANICAL JOINTS MAY BE SUBSTITUTED FOR PVC PIPE.
 - SANITARY SEWER PIPE SHALL HAVE A MINIMUM DEPTH OF 6' FEET. PERCENTAGE OF GRADES LISTED FOR SANITARY SEWER LINES WERE CALCULATED FROM THE CENTERLINE OF ONE MANHOLE TO THE CENTERLINE OF THE NEXT MANHOLE.
 - SEWER SERVICE LATERALS SHALL BE COORDINATED WITH BUILDING PLANS, ANY DISCREPANCIES SHOULD BE CLARIFIED BEFORE INSTALLATION. SEWER SERVICE LATERALS ARE TO BE PERMANENTLY MARKED ON THE CURB.
 - ALL MANHOLES REQUIRE KOR-N-SEAL OR EQUAL RUBBER BOOTS.
 - THE TOP ELEVATION OF MANHOLES CONSTRUCTED IN PAVED AREAS SHALL MATCH FINISH GRADE, AND SHALL HAVE TRAFFIC BEARING LIDS. THE TOP ELEVATION OF MANHOLES CONSTRUCTED IN GRASSY AREAS MUST MATCH FINISHED GRADE (UNLESS OTHERWISE NOTED). ALL EXISTING MANHOLES & UTILITY BOXES SHALL BE ADJUSTED AS NECESSARY TO MATCH PROPOSED GRADING.
 - ALL WATER PIPE 4" DIAMETER AND LARGER SHALL BE C900, CLASS 150 PVC WATER PIPE WITH 150 PSI PRESSURE RATING CONFORMING TO AWWA, AND UNIBELL PLASTIC PIPE STANDARD SPECIFICATIONS. FITTINGS 4" AND LARGER SHALL BE CAST IRON OR DUCTILE IRON CONFORM WITH WWA STANDARD SPECIFICATIONS.
 - ALL WATER PIPE 3" AND SMALLER SHALL BE TYPE K COPPER OR SDR 21 PER ANSI 16.22.
 - CONTRACTOR SHALL MAINTAIN A MINIMUM OF 6' OVER ALL WATER LINES.
 - CONTRACTOR SHALL COORDINATE INSTALLATION OF WATER SERVICE WITH WATER DEPARTMENT. CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLATION, PURCHASE AND/OR FEES ASSOCIATED WITH ALL APPARATUS INCLUDING: WATER METERS, BACK FLOW PREVENTERS, POST INDICATOR VALVES, AND ENCLOSURES.
 - THE MINIMUM HORIZONTAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF WATER AND SEWER LINE IS (10') TEN FEET. THE MINIMUM VERTICAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF THE WATER AND SEWER LINES IS (18") EIGHTEEN INCHES.
 - ALL FIRE HYDRANTS SHALL CONFORM TO LOCAL REQUIREMENTS.
 - ALL DOMESTIC WATER LEADS SHALL HAVE REDUCED PRESSURE VALVES AS DIRECTED BY THE OWNER'S ARCHITECT.
 - EXISTING UTILITIES LOCATIONS ARE APPROXIMATE AND SHOULD BE VERIFIED FOR LOCATION AND NUMBER BY THE CONTRACTOR.
 - ALL ELECTRIC, TELEPHONE AND GAS LINES, INCLUDING SERVICE LINES, ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE APPROPRIATE UTILITY COMPANIES SPECIFICATIONS.
 - CONTRACTOR TO COORDINATE INSTALLATION OF ALL UTILITIES BY OTHERS WITH HIS WORK.
 - PRIMARY ELECTRIC SERVICE IS PROVIDED BY THE POWER COMPANY. THIS INCLUDES THE TRANSFORMER AND PAD, TRENCHING, BACKFILL AND COMPACTION. CONTRACTOR IS RESPONSIBLE FOR COORDINATION AND FEES ASSOCIATED WITH POWER SERVICE AS WELL AS SECONDARY SERVICE.
 - GAS LINES ARE INDICATED FOR COORDINATION ONLY. CONTRACTOR IS RESPONSIBLE FOR COORDINATION AND FEES ASSOCIATED WITH GAS SERVICE.
 - GAS AND UNDERGROUND ELECTRIC LINES ARE SHOWN FOR COORDINATION ONLY. EXACT LOCATION WILL BE FIELD DETERMINED DURING CONSTRUCTION.

CONTRACTOR PLEASE NOTE THERE EXISTS UNDERGROUND PRIMARY IN THE AREA OF THE STORM DRAIN AND DUMPSITE. PLEASE COORDINATE WITH GEORGIA POWER / SOUTHERN COMPANY PRIOR TO ANY EXCAVATION. ALL CROSSINGS SHALL BE BENEATH.

THE SEWERS, SEWER LATERALS, SEWER CLEANOUTS, DO NOT CROSS A WETLAND STATE WATER AND OR OTHER WATER BODY.

ALL UNSUITABLE EXCAVATED MATERIAL MUST BE PROPERLY DISPOSED OF IN A MANNER ACCEPTABLE TO THE ATHENS-CLARKE COUNTY GOVERNMENT AND IN A MANNER THAT WILL NOT ADVERSELY IMPACT THE ENVIRONMENT.

BYPASSING OF RAW WASTEWATER ONTO THE GROUND OR INTO A RECEIVING STREAM IS PROHIBITED BY LAW.

ALL CONSTRUCTION WILL COMPLY WITH THE DEPARTMENT OF LABOR OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION, 29 CFR PART 1926, LATEST EDITION.

NONE OF THE SEWERS, SERVICES, OR ANY OTHER UTILITIES ASSOCIATED WITH THIS PROJECT ARE CONSTRUCTED OR PROPOSED TO BE CONSTRUCTED ON A SOLID WASTE LANDFILL.

PARCEL # 074 A003
GMD 241 & 1467
CITY OF ATHENS,
CLARKE COUNTY, GEORGIA

REVISIONS:	
PROJECT:	HARDEE'S
PROJECT ADDRESS:	3075 ATLANTA HWY
PROJECT ADDRESS:	ATHENS, GA 30606
CLIENT:	CGP ACQUISITIONS & DEVELOPMENT, LLC
CLIENT ADDRESS:	3615 SUMMIT BLVD STE 110
CLIENT ADDRESS:	BIRMINGHAM, AL 35243
DATE:	03/01/17
DWG:	PRJI

Civil Consulting Engineers, Inc.

einc.

122 CEDAR WOODS TRAIL
CANTON, GA 30114
678-462-4072
CIVILCONSULTINGENGINEERSINC.COM